


SYSTEM COMPONENTS _ DISTRIBUTION KNX LINES

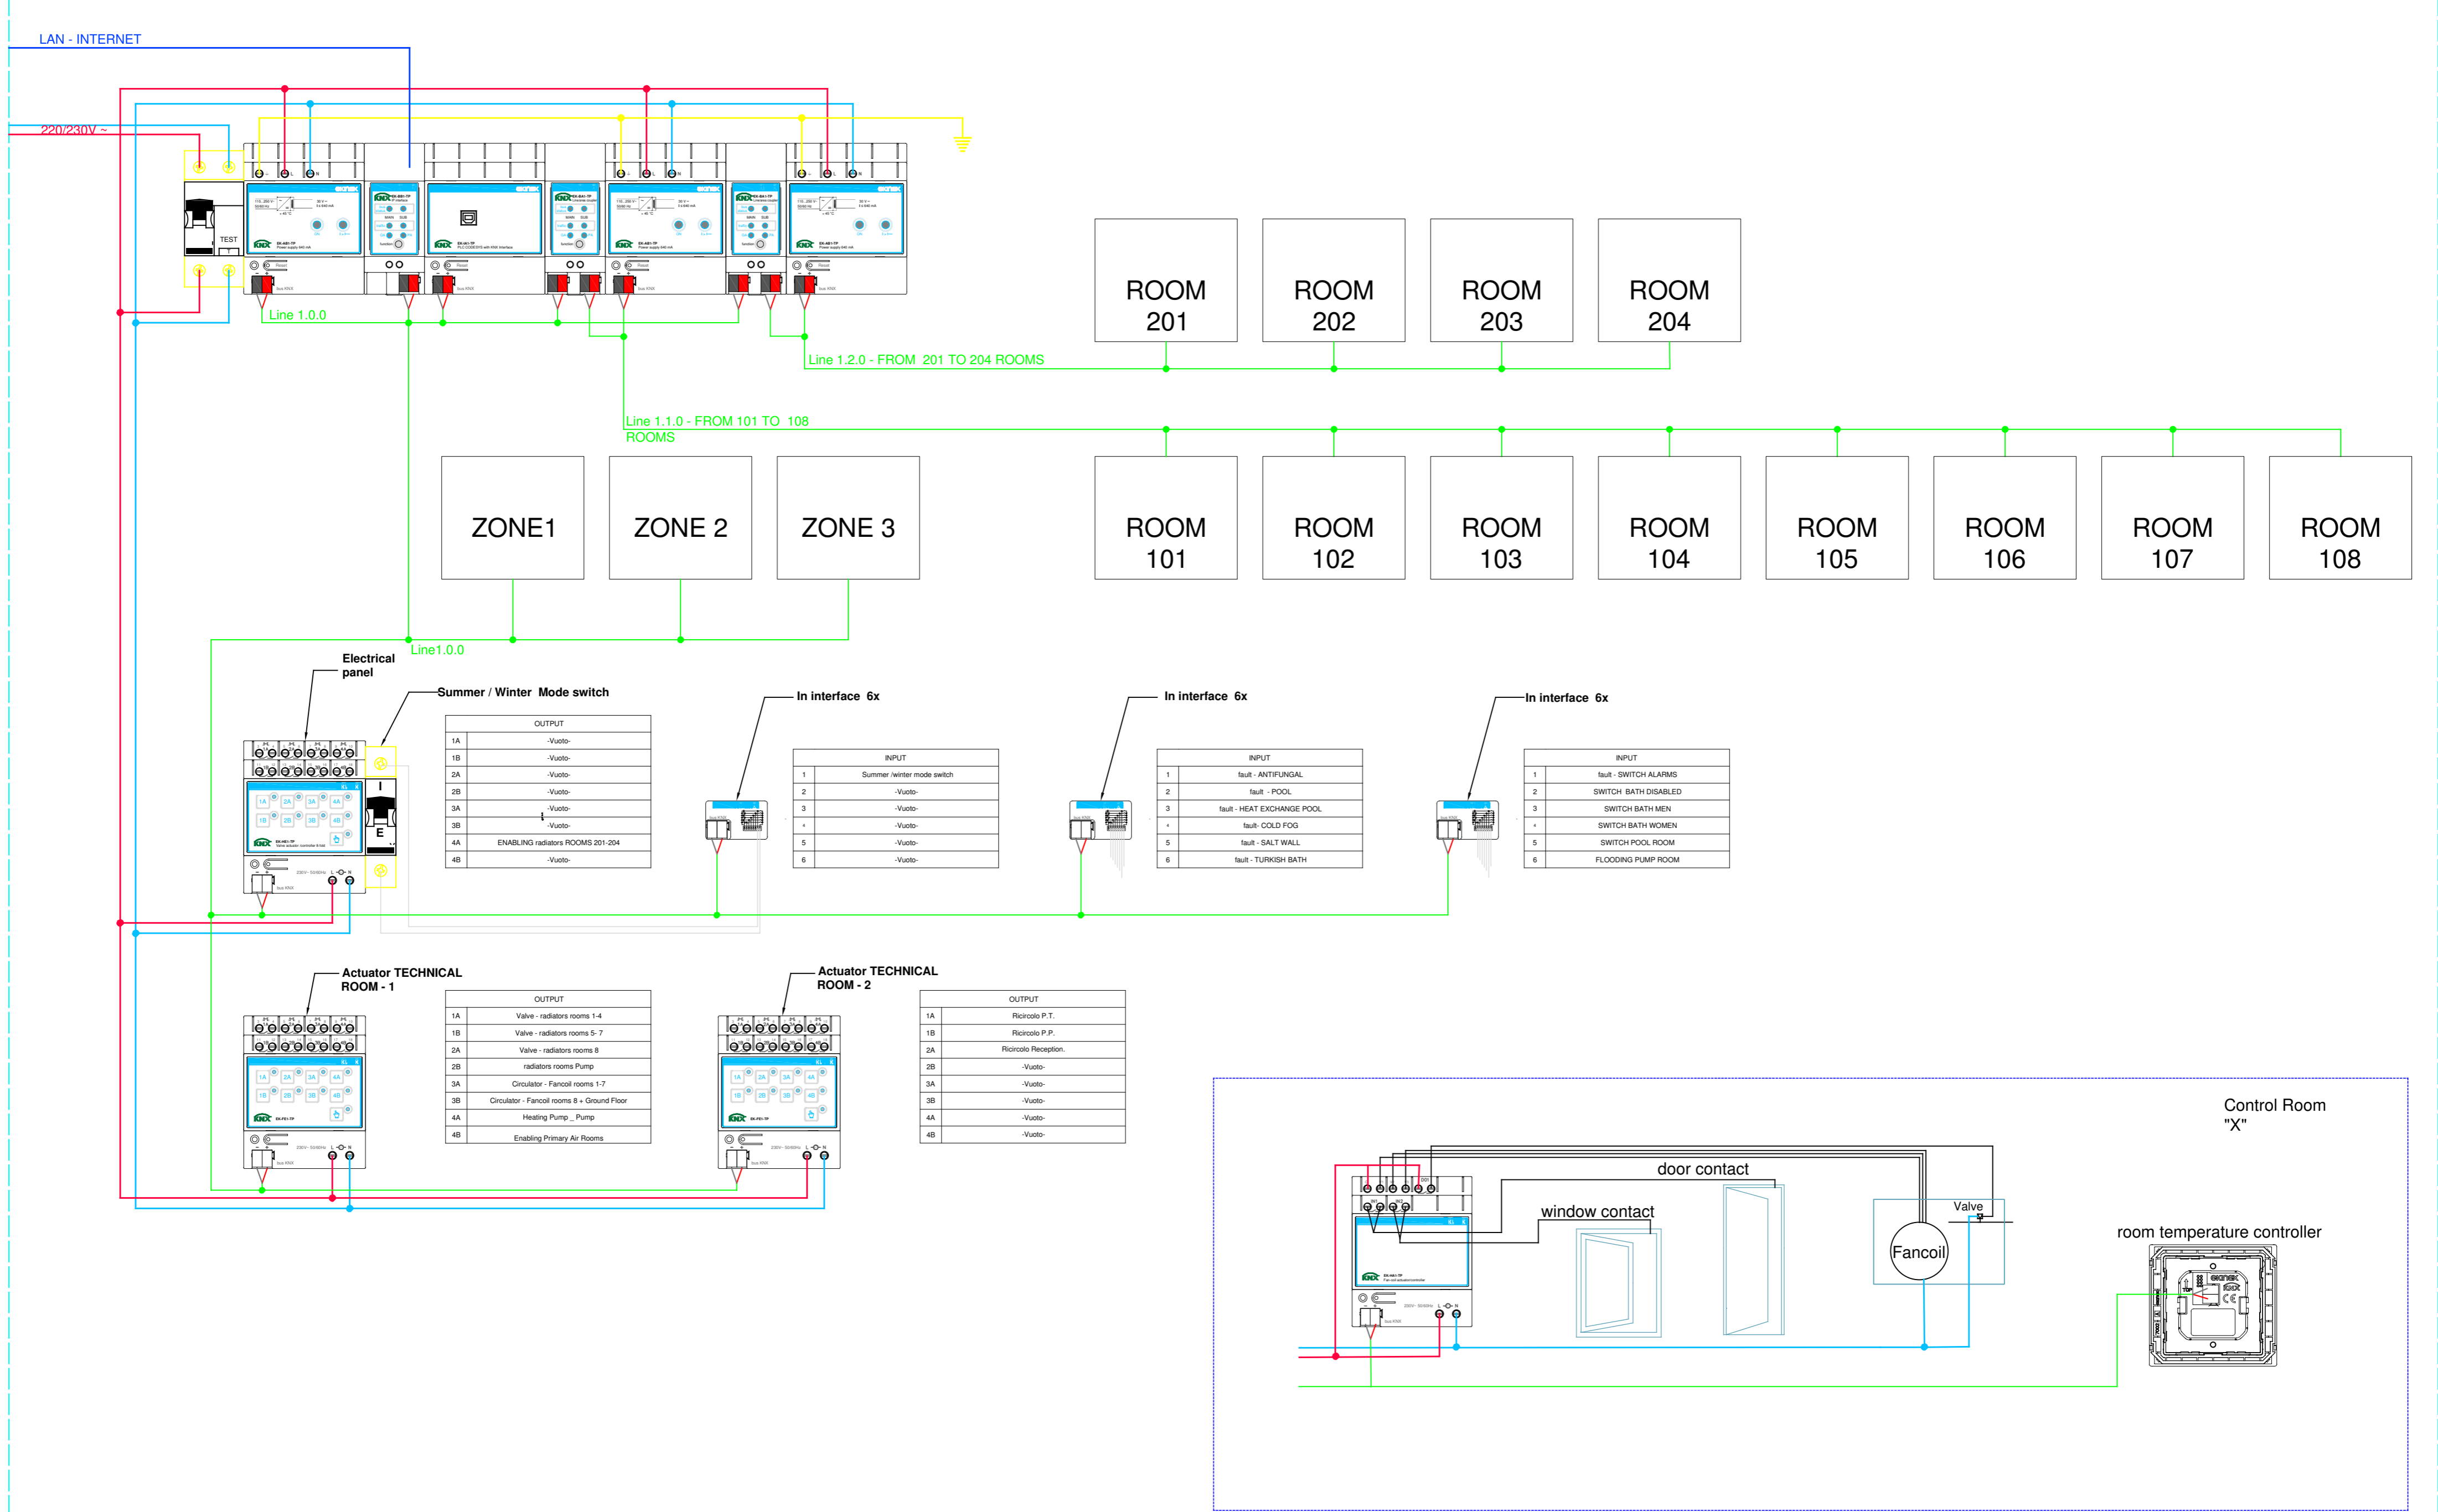

OUTPUT

1A	-Vuoto-
1B	-Vuoto-
2A	-Vuoto-
2B	-Vuoto-
3A	-Vuoto-
3B	-Vuoto-
4A	ENABLING radiators ROOMS 201-204
4B	-Vuoto-

INPUT

1	Summer /winter mode switch
2	-Vuoto-
3	-Vuoto-
4	-Vuoto-
5	-Vuoto-
6	-Vuoto-

INPUT

1	fault - ANTIFUNGAL
2	fault - POOL
3	fault - HEAT EXCHANGE POOL
4	fault - COLD FOG
5	fault - SALT WALL
6	fault - TURKISH BATH

INPUT

1	fault - SWITCH ALARMS
2	SWITCH BATH DISABLED
3	SWITCH BATH MEN
4	SWITCH BATH WOMEN
5	SWITCH POOL ROOM
6	FLOODING PUMP ROOM

OUTPUT

1A	Valve - radiators rooms 1-4
1B	Valve - radiators rooms 5- 7
2A	Valve - radiators rooms 8
2B	radiators rooms Pump
3A	Circulator - Fancoil rooms 1-7
3B	Circulator - Fancoil rooms 8 + Ground Floor
4A	Heating Pump_Pump
4B	Enabling Primary Air Rooms

OUTPUT

1A	Ricicolo P.T.
1B	Ricicolo P.P.
2A	Ricicolo Reception.
2B	-Vuoto-
3A	-Vuoto-
3B	-Vuoto-
4A	-Vuoto-
4B	-Vuoto-

